



CERTIFICATE OF APPROVAL

No CF 5661

This is to certify that, in accordance with
TS00 General Requirements for Certification of Fire Protection Products
The undermentioned products of

FISCHERWERKE GMBH & CO. KG

Klaus fischer Straße 1, 72178 Waldachtal, Germany

Tel: +49 7443 120

Have been assessed against the requirements of the Technical Schedule(s)
denoted below and are approved for use subject to the conditions
appended hereto:

CERTIFIED PRODUCT
FiPW-E Endless Pipe Wrap

TECHNICAL SCHEDULE
**TS 03 Penetration Sealing
Systems**

Signed and sealed for and on behalf of Warringtonfire Testing and Certification Limited

Paul Duggan
Certification Manager



Issued: 5th June 2019
Valid to: 7th December 2020

Page 1 of 12





CERTIFICATE No CF 5661

FISCHERWERKE GMBH & CO. KG

1. This approval relates to the use of FiPW-E Endless Pipe Wrap for the fire protection where services are penetrating walls and floors. The detailed scope is given in the Approval Matrix included in this Certificate. This shows the thickness and acceptable services for FiPW-E Endless Pipe Wrap required to provide fire resistance periods in accordance with BS EN 1366-3: 2009 of up to 120 minutes for differing services and substrate constructions. The scope of certification complies with the guidelines stated in the ASFP Red Book: 3rd Edition for 3rd party certification schemes.
2. The product is approved on the basis of:
 - i) Initial type testing
 - ii) Audit testing at the frequency specified in TS03
 - iii) A design appraisal against TS03
 - iv) Inspection and surveillance of factory production control
3. The walls shall be at least 100 mm thick and have at least the same fire rating as that required for the penetration seal. The floors shall be at least 150 mm thick and have at least the same fire rating as that required for the penetration seal
4. The services which may be fitted through the seals are PVC, ABS, PP and PE pipes of various sizes, as detailed within the Approval Matrix included in this Certificate.
5. The approval relates to ongoing production. Product and/or its immediate packaging is identified with the manufacturers' name, the product name or number, the CERTIFIRE name or name and mark, together with the CERTIFIRE certificate number and application where appropriate.
6. This certification is provided to the client for their own purposes and we cannot opine on whether it will be accepted by Building Control authorities or any other third parties for any purpose.

Further Information

Further information regarding the details contained in this data sheet may be obtained from fischerwerke GmbH & Co. KG (Tel: +49 7443 120).

Further information regarding CERTIFIRE certification and other approved products can be obtained from CERTIFIRE (Tel: 01925 646777).





CERTIFICATE No CF 5661
FISCHERWERKE GMBH & CO. KG

FiPW-E Endless Pipe Wrap- Approval Matrix Floors 150mm min.



Product Name:	FiPW-E Endless Pipe Wrap Installed Both Sides of 150mm thick Rigid Floor		
Maximum Annulus:	12mm filled with min 5mm deep fischer FiAM Intumescent Acoustic Mastic		
Floors	The floors shall be a minimum of 150 mm thick. All concrete floors shall have at least the same fire rating as that required of the FiPW-E Endless Pipe Wrap.		
Application Technique:	The FiPW-E Endless Pipe Wrap is folded around the pipe the required number of times and inserted into the annular space between the pipe and floor.		
Service Coat-Back :	Not required	U Value:	Not known
Service Support Requirements:	Services should be rigidly supported via steel angles, hangars or channels, not further than 400 mm from the upper surface of the seal.		
Resistance to Smoke:	Not evaluated by this approval	Weather Capability:	Not evaluated by this approval
Acoustic Rating:	Not evaluated by this approval	Movement Capability:	Not evaluated by this approval

Intumescent Thickness	
Pipe Diameter	Intumescent Material
ø 32 mm - ø 50 mm	1 off 40 mm (W) x 2 (T)
ø 51 mm - ø 82 mm	2 off 40 mm (W) x 2 (T)
ø 83 mm - ø 115 mm	3 off 40 mm (W) x 2 (T)
ø 116 mm - ø 160 mm	4 off 40 mm (W) x 2 (T)
ø 161 mm - ø 200 mm	5 off 40 mm (W) x 2 (T)
ø 201 mm - ø 250 mm	6 off 40 mm (W) x 2 (T)



CERTIFICATE No CF 5661 FISCHERWERKE GMBH & CO. KG

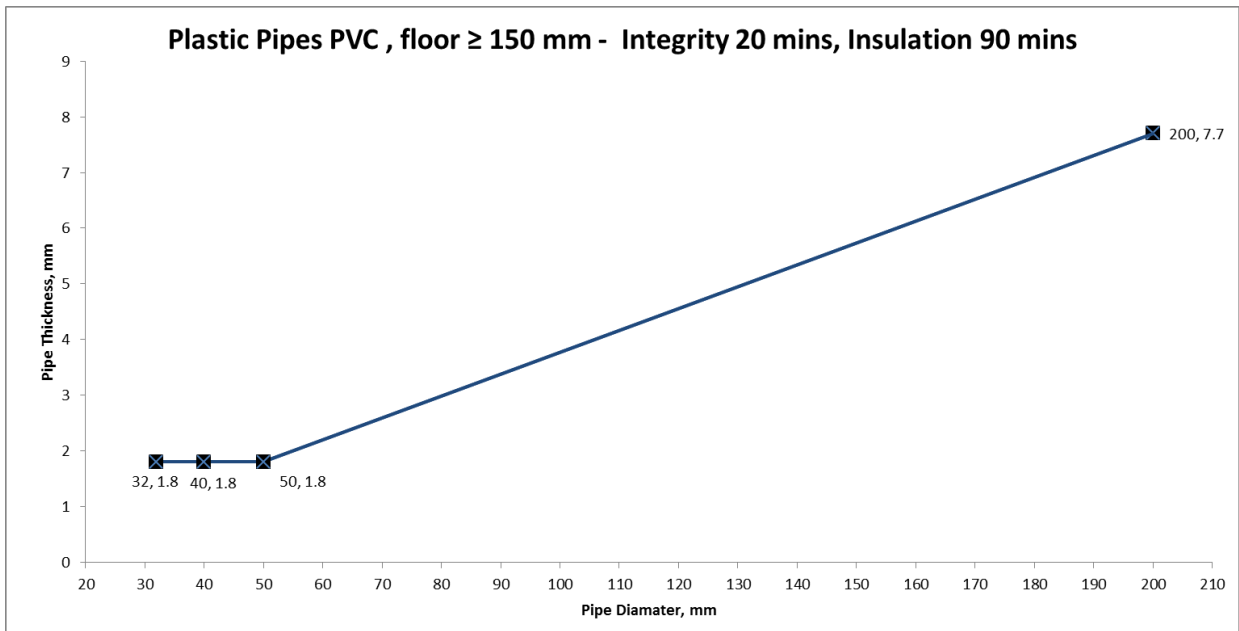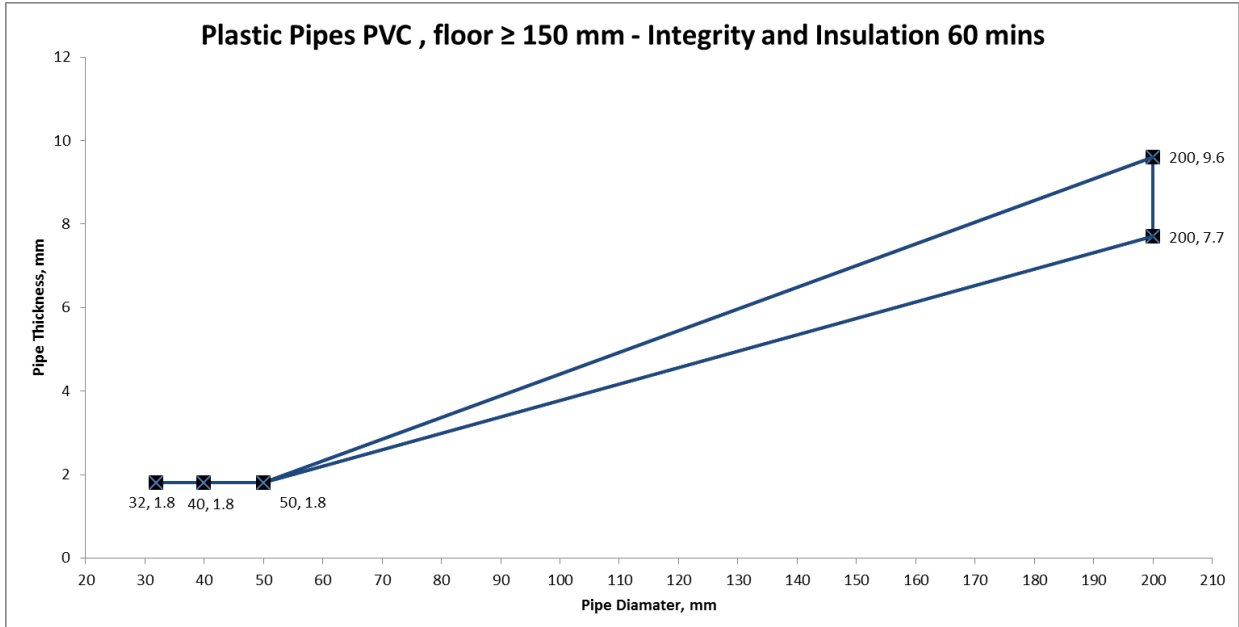


CERTIFICATE No CF 5661 FISCHERWERKE GMBH & CO. KG

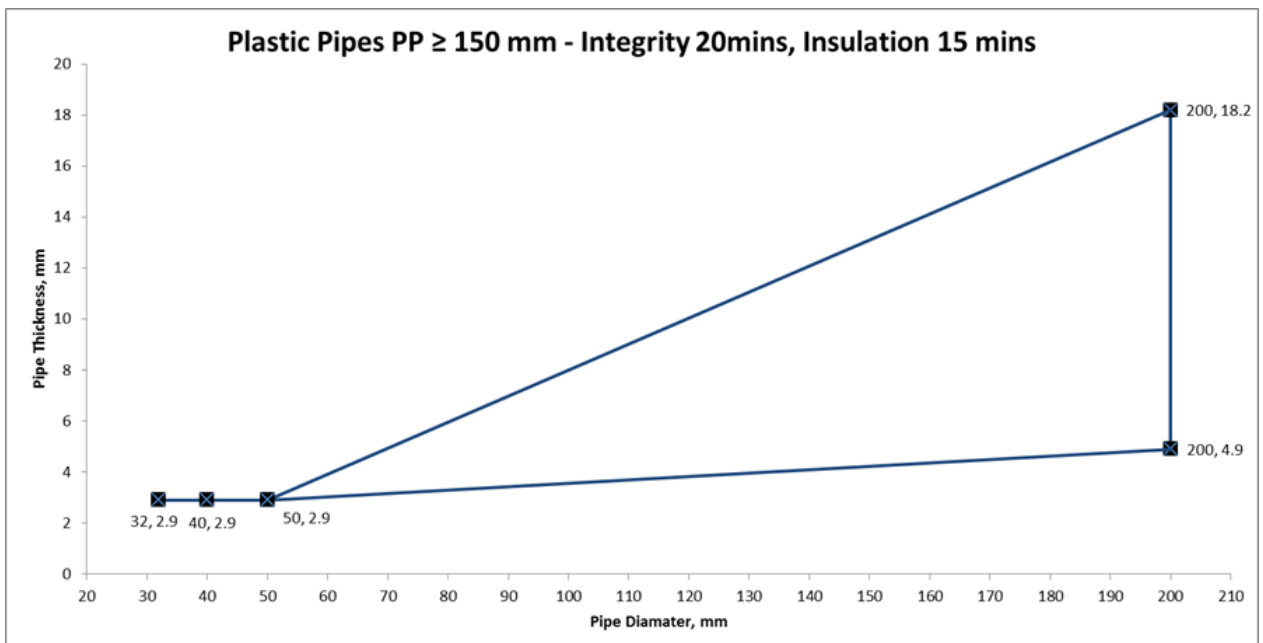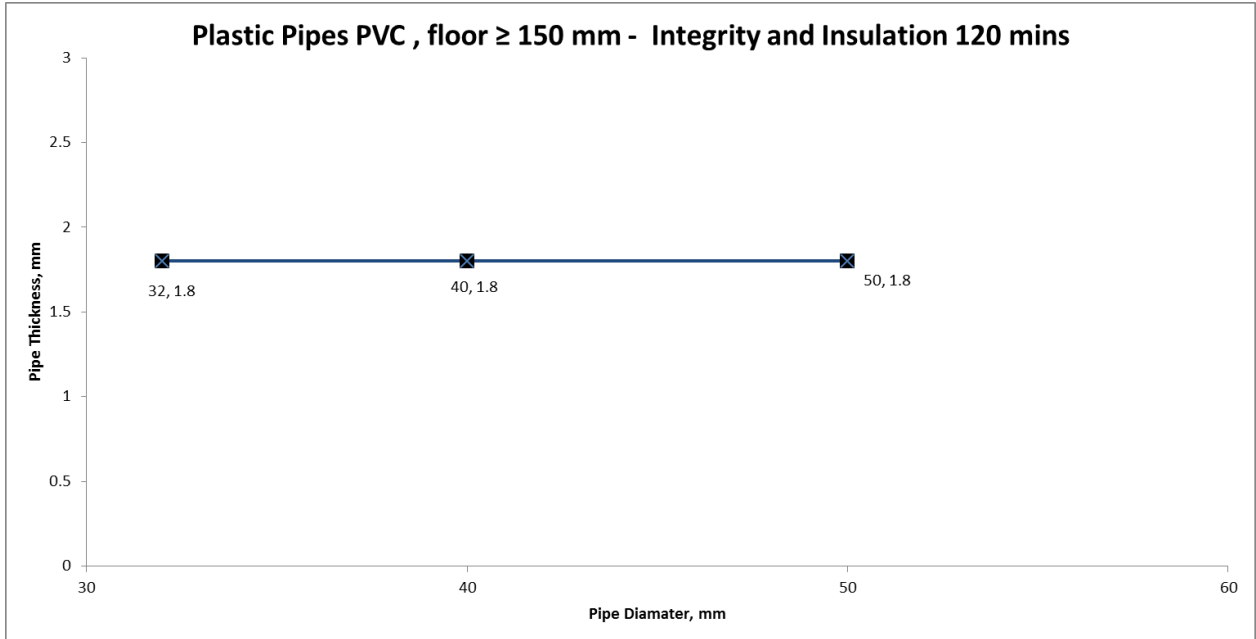

CERTIFICATE No CF 5661 FISCHERWERKE GMBH & CO. KG

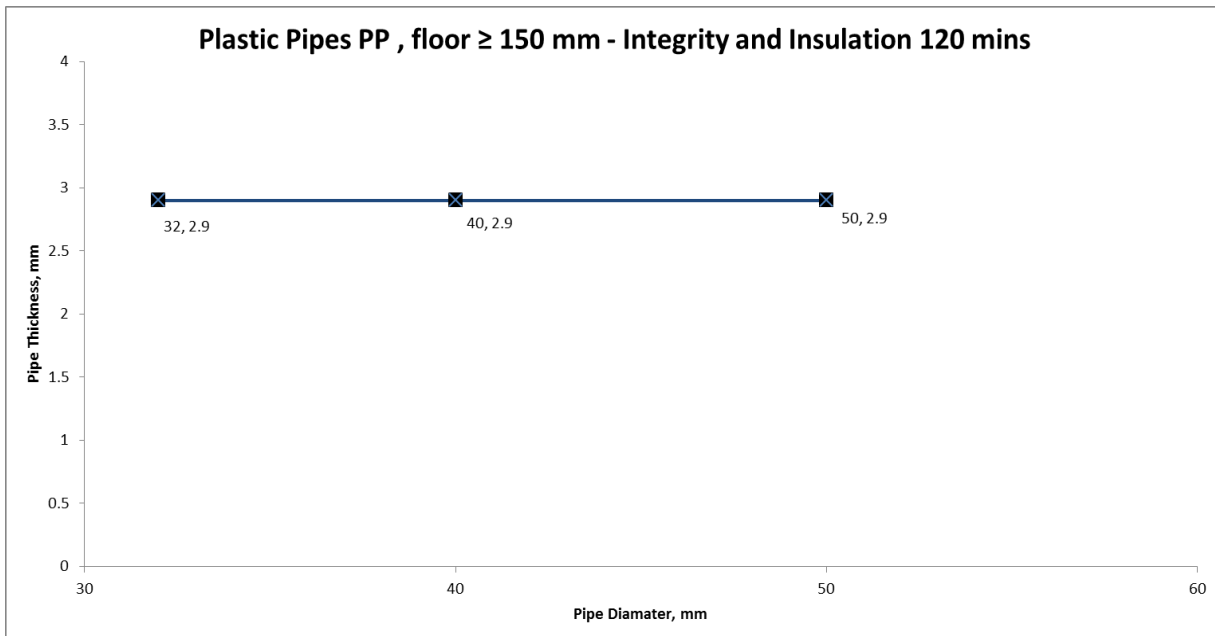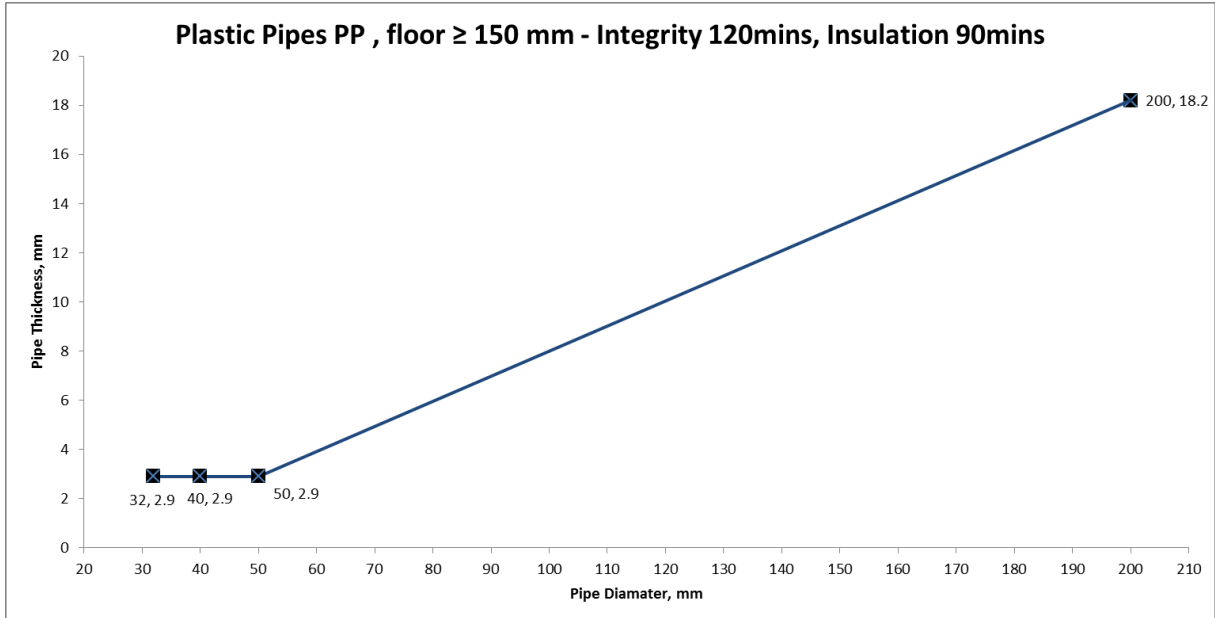

CERTIFICATE No CF 5661 FISCHERWERKE GMBH & CO. KG

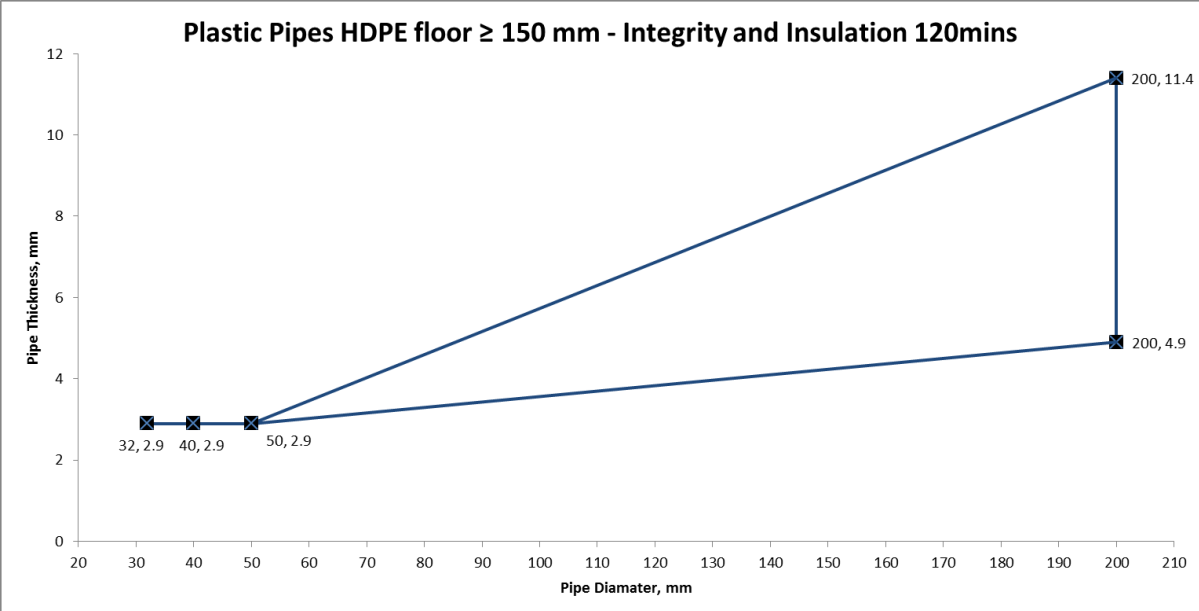





CERTIFICATE No CF 5661
FISCHERWERKE GMBH & CO. KG

FiPW-E Endless Pipe Wrap- Approval Matrix Walls 100mm min.



Product Name:	FiPW-E Endless Pipe Wrap Installed Both Sides of 100mm thick rigid or flexible wall		
Maximum Annulus:	12mm filled with min 5mm deep fischer FiAM Intumescent Acoustic Mastic		
Walls	The walls shall be a minimum of 100 mm thick. All concrete or plasterboard shall have at least the same fire rating as that required of the FiPW-E Endless Pipe Wrap.		
Application Technique:	The FiPW-E Endless Pipe Wrap is folded around the pipe the required number of times and inserted into the annular space between the pipe and wall.		
Service Coat-Back :	Not required	U Value:	Not known
Service Support Requirements:	Services should be rigidly supported via steel angles, hangars or channels, not further than 400 mm from the upper surface of the seal.		
Resistance to Smoke:	Not evaluated by this approval	Weather Capability:	Not evaluated by this approval
Acoustic Rating:	Not evaluated by this approval	Movement Capability:	Not evaluated by this approval

Intumescent Thickness	
Pipe Diameter	Intumescent Material
ø 32 mm - ø 50 mm	1 off 40 mm (W) x 2 (T)
ø 51 mm - ø 82 mm	2 off 40 mm (W) x 2 (T)
ø 83 mm - ø 115 mm	3 off 40 mm (W) x 2 (T)
ø 116 mm - ø 160 mm	4 off 40 mm (W) x 2 (T)
ø 161 mm - ø 200 mm	5 off 40 mm (W) x 2 (T)
ø 201 mm - ø 250 mm	6 off 40 mm (W) x 2 (T)

CERTIFICATE No CF 5661 FISCHERWERKE GMBH & CO. KG

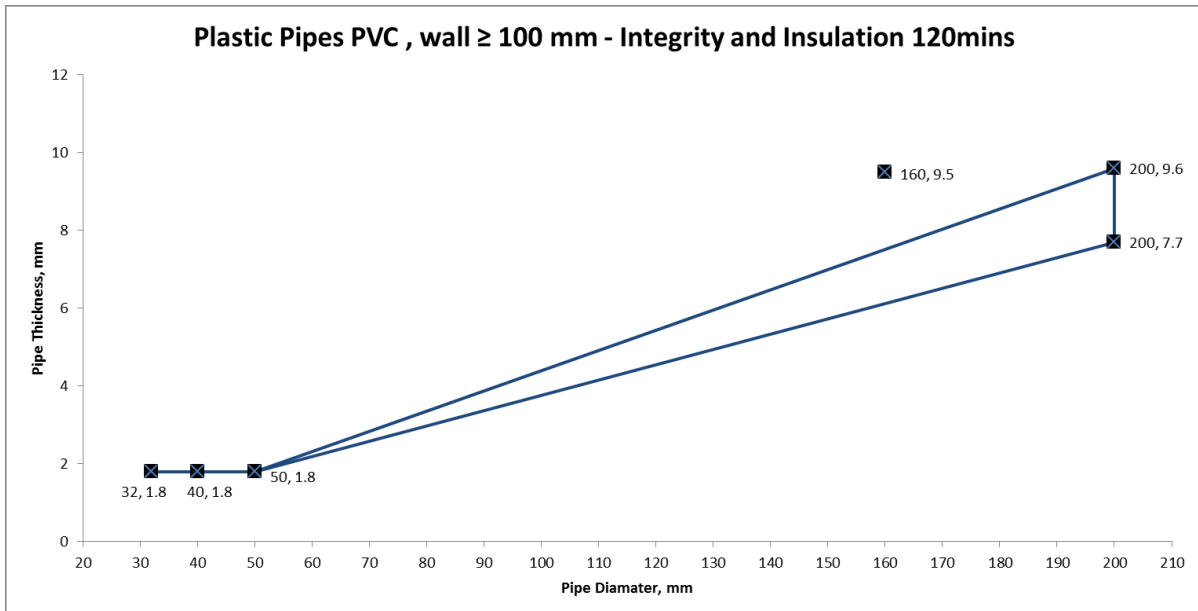
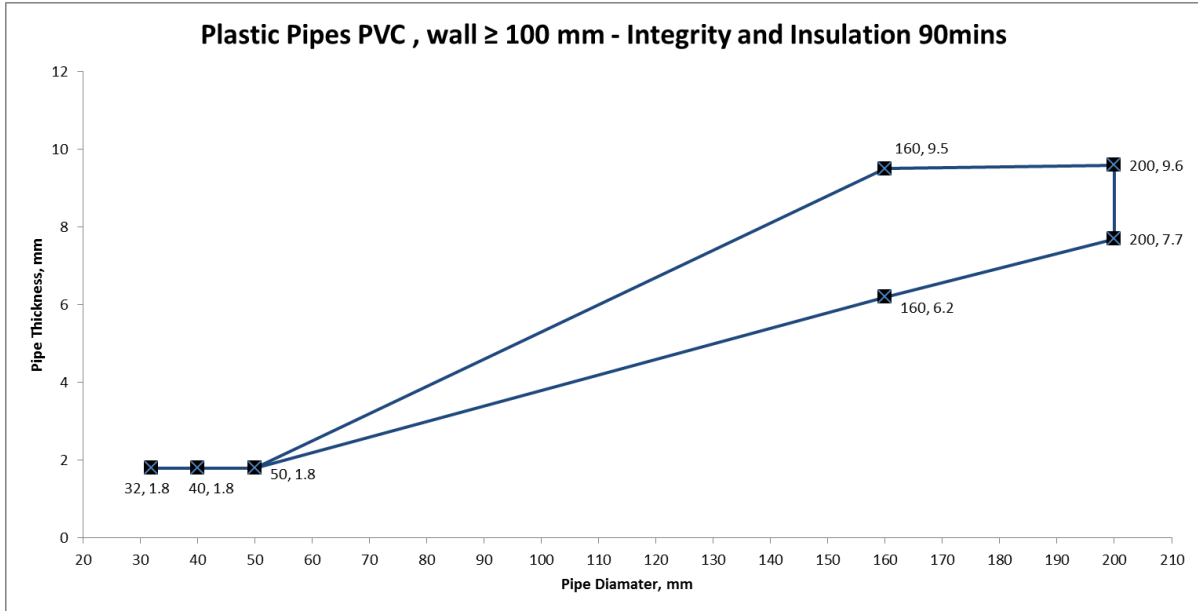


CERTIFICATE No CF 5661 FISCHERWERKE GMBH & CO. KG

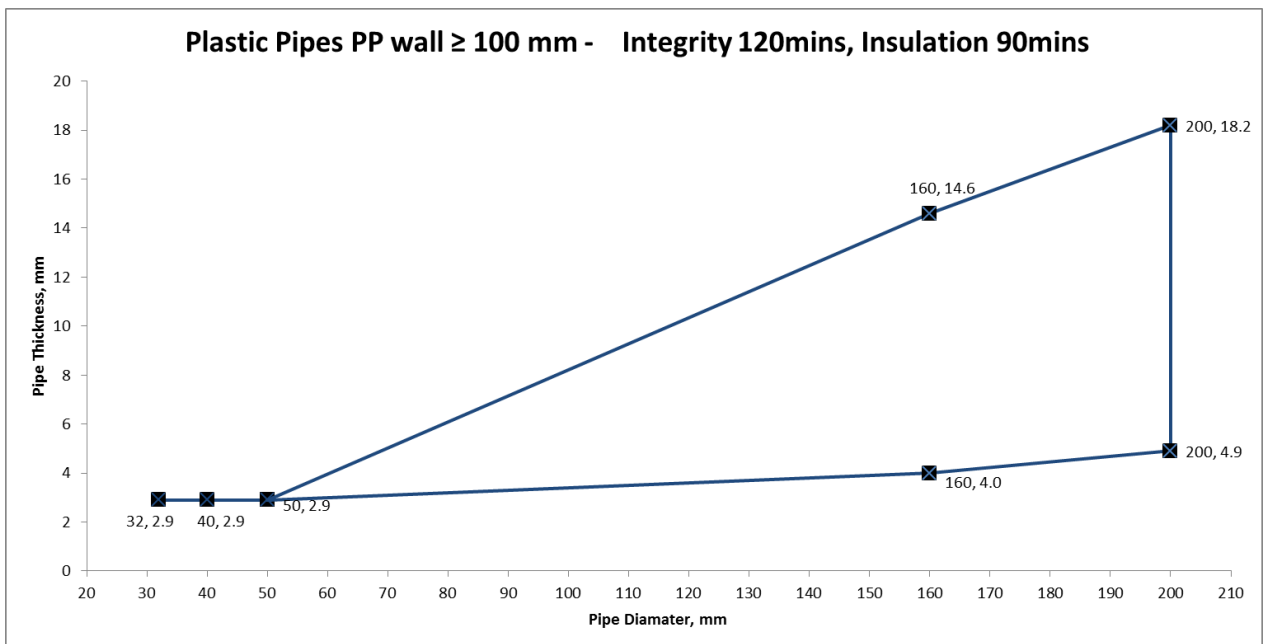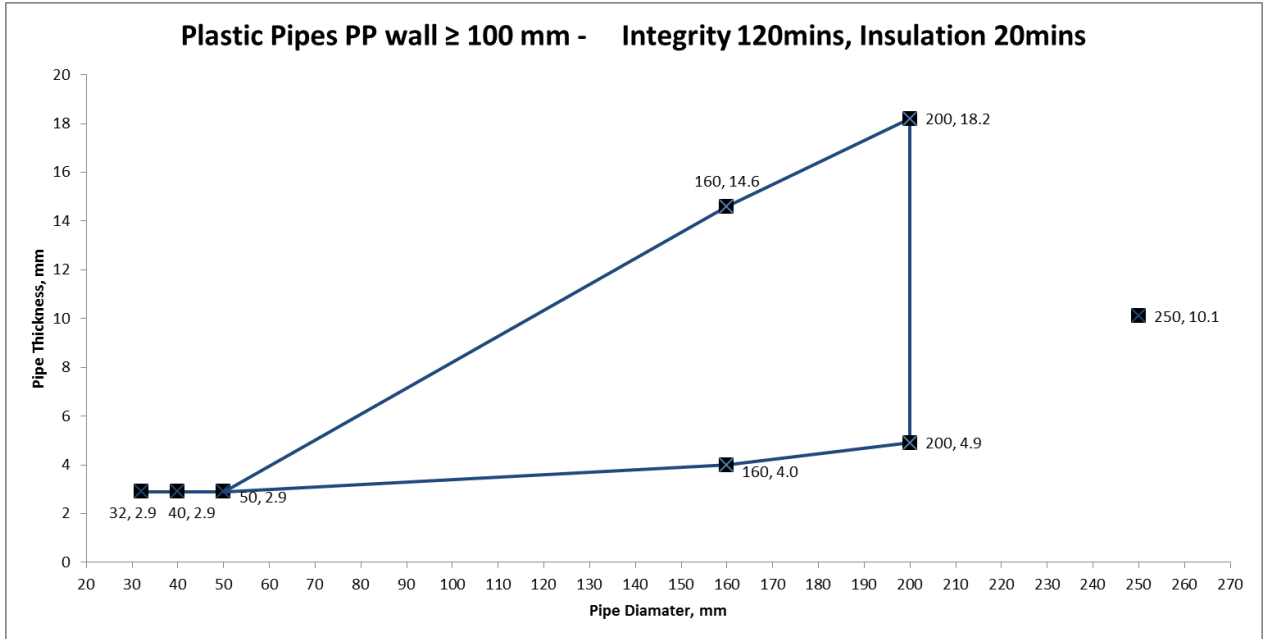

Paul Hogg

CERTIFICATE No CF 5661 FISCHERWERKE GMBH & CO. KG

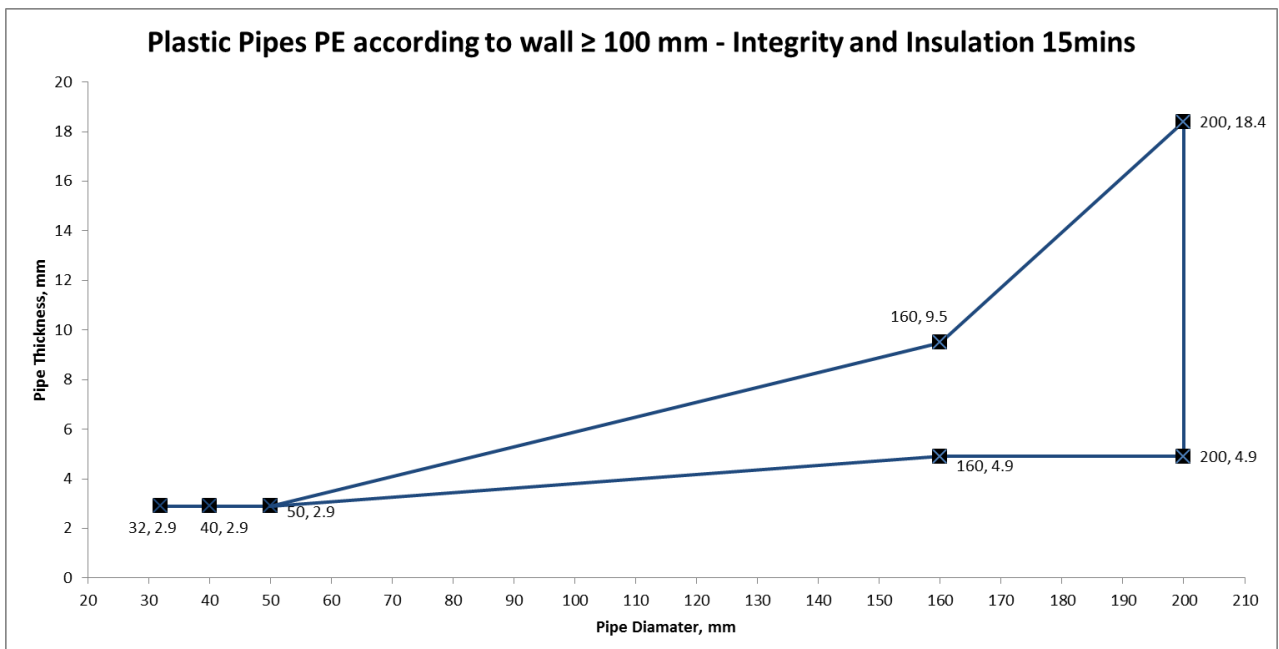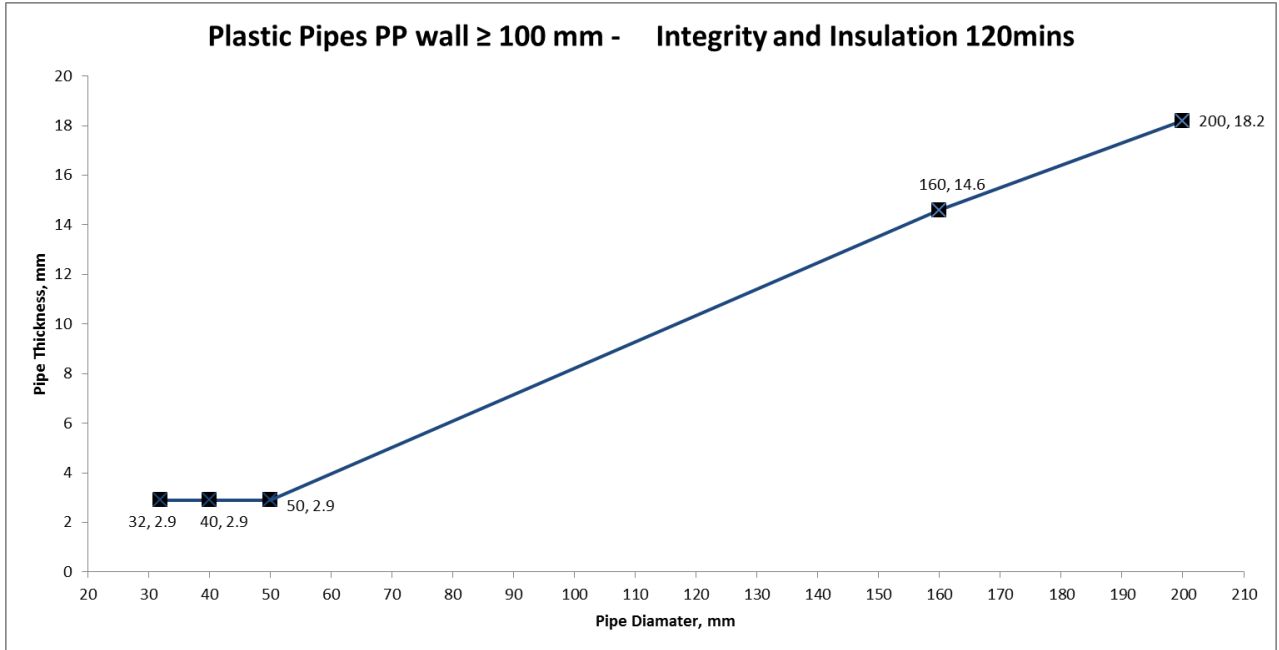

CERTIFICATE No CF 5661 FISCHERWERKE GMBH & CO. KG

